


AC UNIT SCHEDULE												
AREA/BUILDING	ROOM	UNIT #	TYPE	TC	TS	TH	SA (L/s)	FA (L/s)	RA (L/s)	ON COIL TEMP.	OFF COIL TEMP.	ELIC: (Local Isolator by Site)
MAIN BUILDING	SLEEP POD	AC-001	MIXED	3.0W	2.5W	0	20	20	20	24°C	24°C	1.5W / 2000° F
MAIN BUILDING	SLEEP POD	AC-002	MIXED	3.0W	2.5W	0	20	20	20	24°C	24°C	1.5W / 2000° F
MAIN BUILDING	SLEEP POD	AC-003	MIXED	3.0W	2.5W	0	20	20	20	24°C	24°C	1.5W / 2000° F
MAIN BUILDING	SLEEP POD	AC-004	MIXED	3.0W	2.5W	0	20	20	20	24°C	24°C	1.5W / 2000° F
MAIN BUILDING	OFFICE	AC-005	MIXED	5.0W	4.25W	0	20	25	25	24°C	24°C	2.0W / 2000° F
MAIN BUILDING	OFFICE	AC-006	MIXED	5.0W	4.25W	0	20	25	25	24°C	24°C	2.0W / 2000° F
MAIN BUILDING	OFFICE	AC-007	MIXED	5.0W	4.25W	0	20	25	25	24°C	24°C	2.0W / 2000° F
MAIN BUILDING	BOILER/ROOM	AC-008	MIXED	5.0W	4.25W	0	20	25	25	24°C	24°C	2.0W / 2000° F
MAIN BUILDING	BOILER/ROOM	AC-009	MIXED	5.0W	4.25W	0	20	25	25	24°C	24°C	2.0W / 2000° F
MAIN BUILDING	BOILER/ROOM	AC-010	MIXED	5.0W	4.25W	0	20	25	25	24°C	24°C	2.0W / 2000° F
MAIN BUILDING	STORAGE/AN OFFICE	AC-011	MIXED	10.0W	8.50W	0	20	25	25	24°C	24°C	4.0W / 2000° F
MAIN BUILDING	STORAGE/AN OFFICE	AC-012	MIXED	10.0W	8.50W	0	20	25	25	24°C	24°C	4.0W / 2000° F
MAIN BUILDING	ALUMINUM	AC-013	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-014	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-015	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-016	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-017	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-018	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-019	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-020	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-021	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-022	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-023	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-024	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-025	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-026	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-027	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-028	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-029	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-030	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-031	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-032	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 2000° F
MAIN BUILDING	GENIE OPERATORS	AC-033	MIXED	11.0W	11.00W	0	20	25	25	24°C	24°C	4.5W / 200

AHU SCHEDULE									
ROOM	UNIT #	TYPE	TC	TS	TH	AC Supply Air	AC Fresh Air	AC Return Air	ELEC (Local Isolator By Site Electrician)
MARI BASSAGE	AHU1 (0.01)	AHU1	23.0kW	58.0kW		9300 L/s	0 L/s	0 L/s	16.0kW / 160V / 3ph



GROUND FLOOR-GATEHOUSE-HVAC  
1 : 100

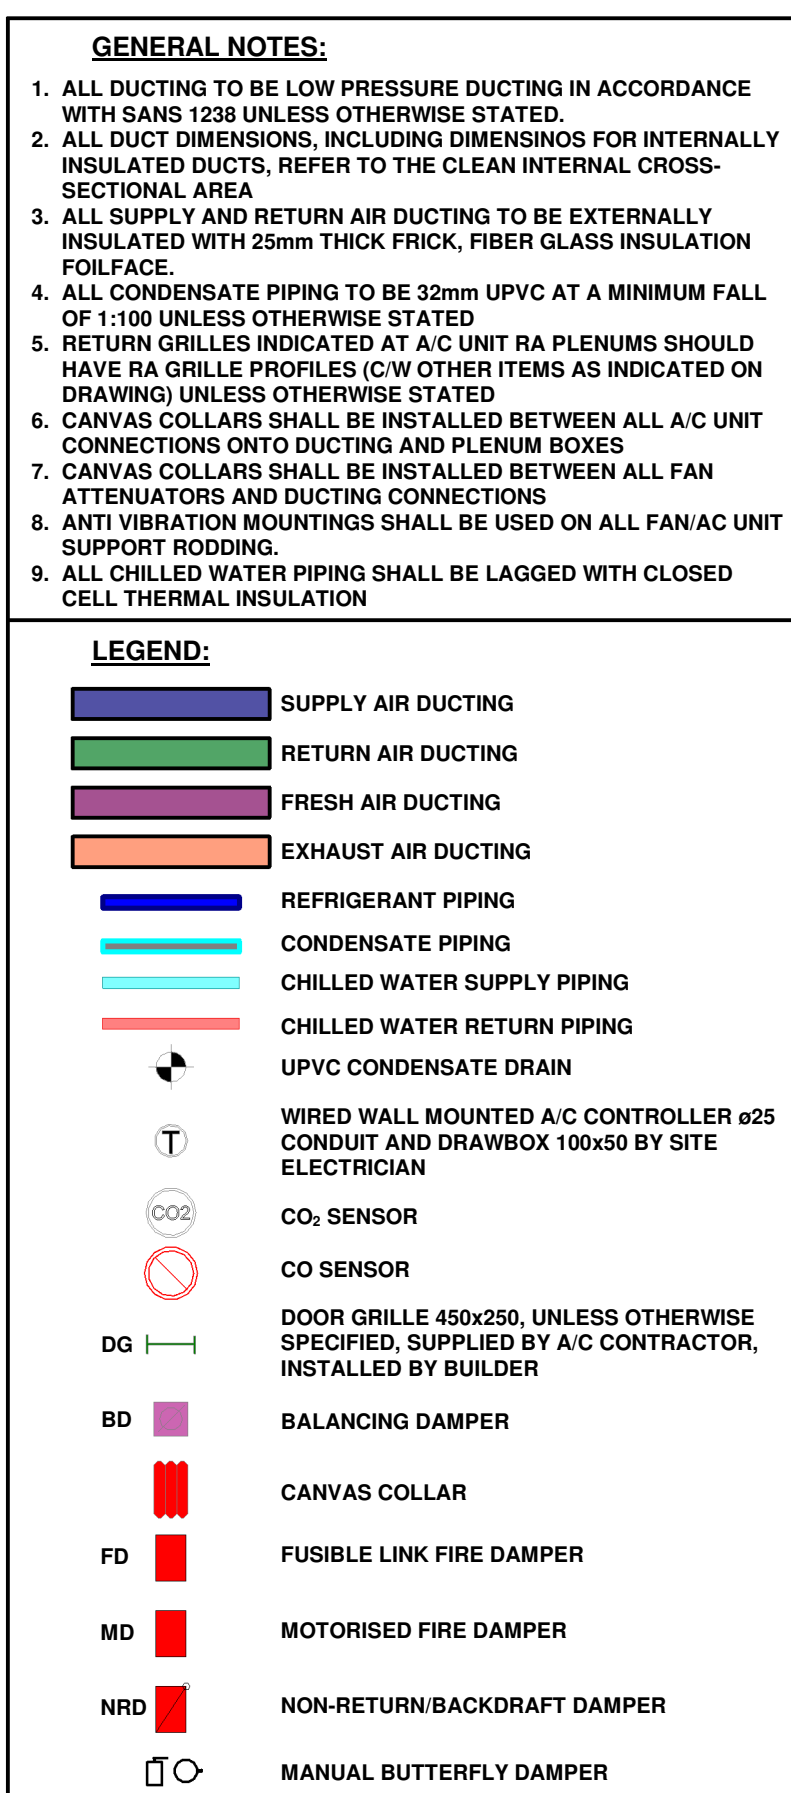

GROUND FLOOR HVAC INSTALLATION

F	P3589-M-01
REVISION	DRAWING NUMBER

Copyright  
Reserved